



Net Energy Injections at Load Busses Quarterly Report


Ken Schuyler,
Manager Renewable Services

Market Implementation Committee
February 8, 2023

- Follow up effort to the Net Energy Metering Senior Task Force (NEMSTF) recommendation
 - PJM will implement a quarterly review to track and trend overall incidents of net energy injections at load busses
- PJM Manual 28 Requirement
 - PJM will assess and trend quarterly the degree of net energy injections at load busses modeled in the PJM network system model (i.e., reverse power flows) in order to detect and correct any modeling issues and to identify any generation in excess of load that appears at a load bus.



PJM Load Busses with Negative Energy on Average

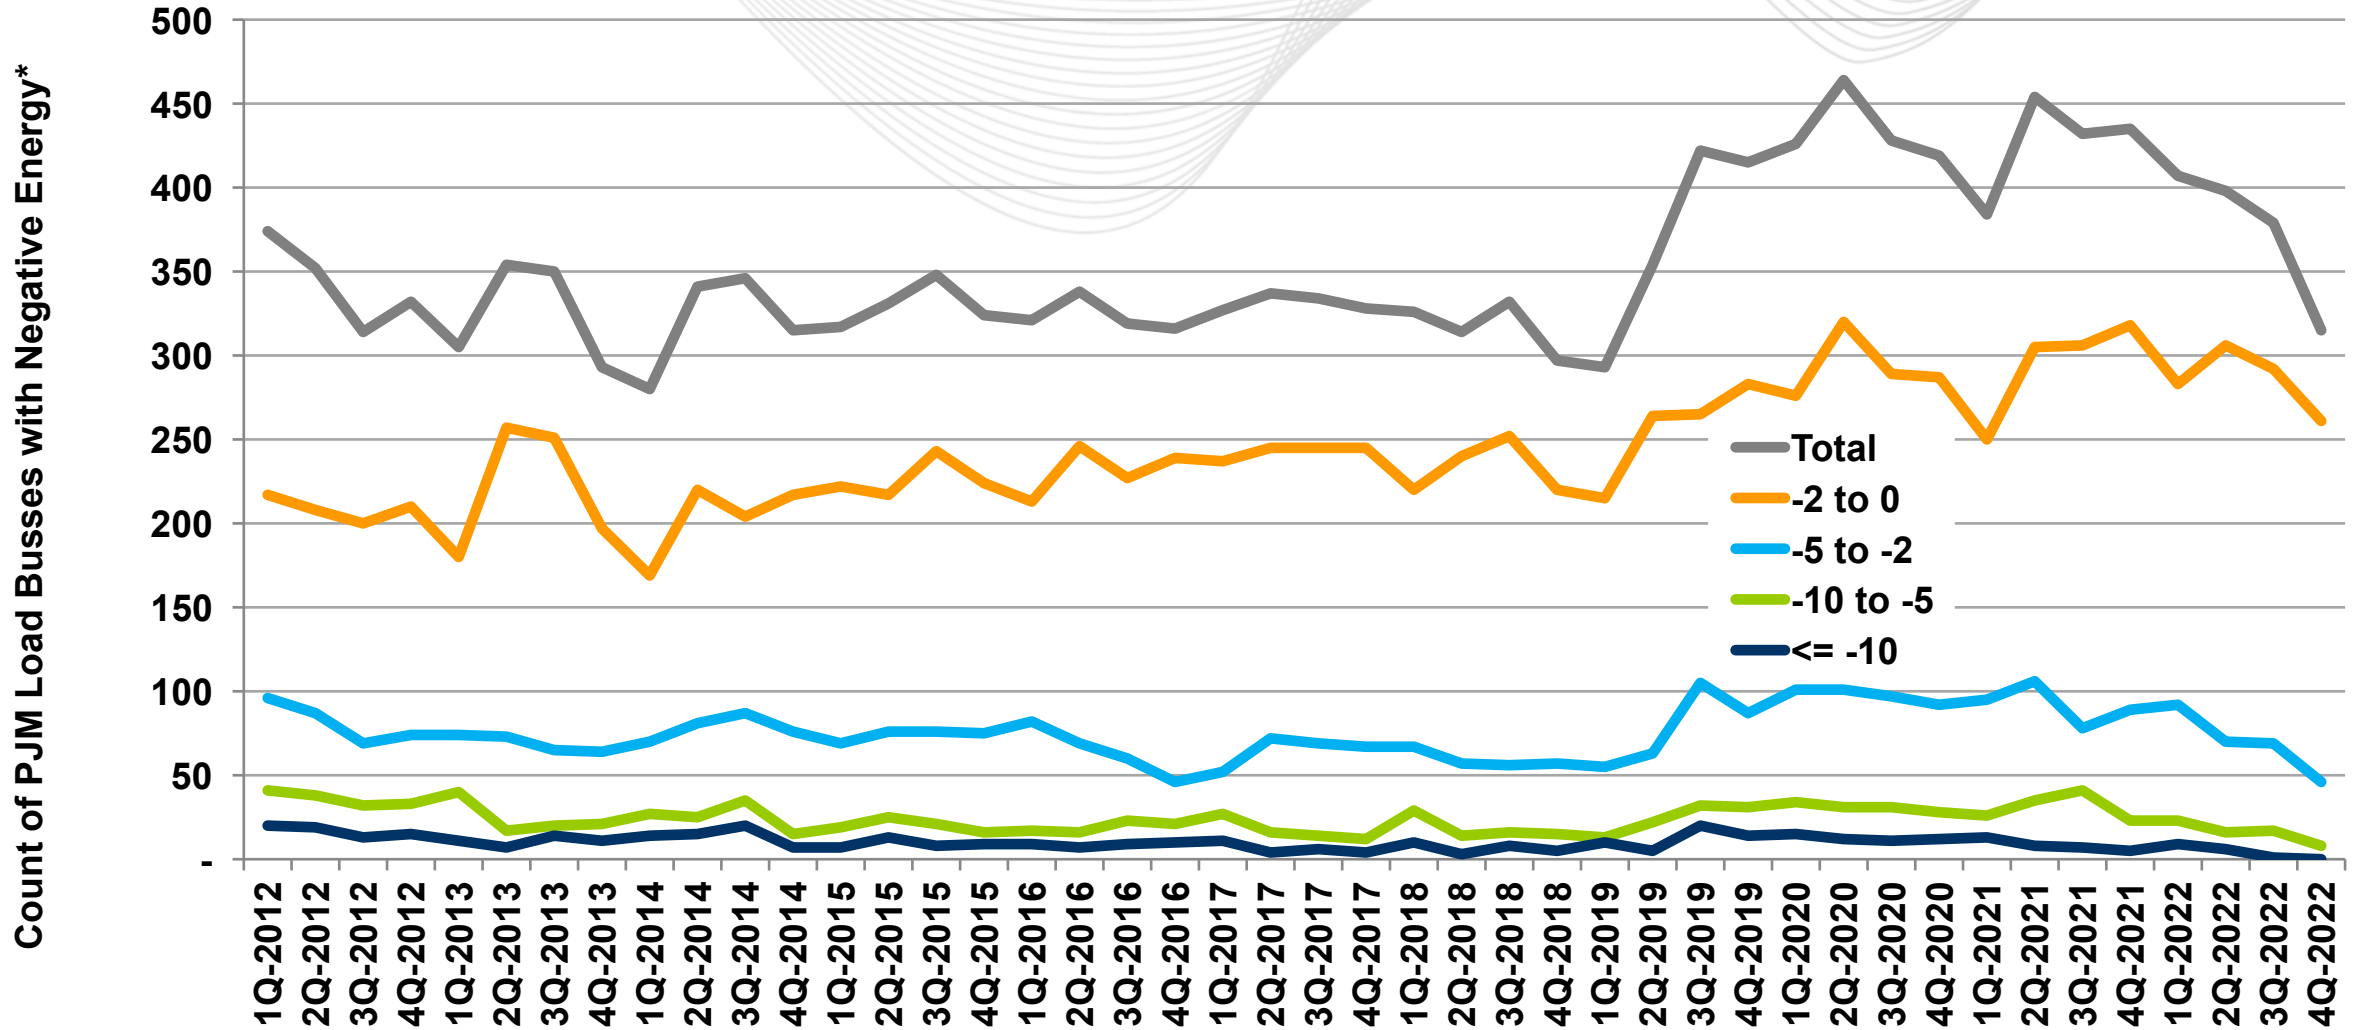

* The total number of PJM load busses is 10,734 as of the most recent model build.

- The total number of load busses with negative energy on average decreased 16.9% in Q4 2022 compared to the previous quarter, and decreased 27.6% compared to the same quarter last year (slide 3).
- The total number of load busses with negative energy on average in Q4 2022 is about 16% lower than when PJM started tracking in 2012 (315 vs 374), even though the total number of load busses (10,734) has increased 32.6% over that ten-year period (slide 3).
- Slides showing figures for a) Mid-Atlantic States and b) New Jersey Zones will be published with the next quarterly update.
- PJM continues to track this data to improve its EMS Network Model. To date, trends have not been indicative of an underlying Net Energy Metering issue.

SME:
Ken Schuyler,
Ken.Schuyler@pjm.com

Net Energy Injections at Load Busses



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com

**PROTECT THE
POWER GRID
THINK BEFORE
YOU CLICK!**



Be alert to
malicious
phishing emails.

Report suspicious email activity to PJM.
(610) 666-2244 / it_ops_ctr_shift@pjm.com

