




Generation Deactivation Notification Update

Transmission Expansion Advisory
Committee
April 6, 2021

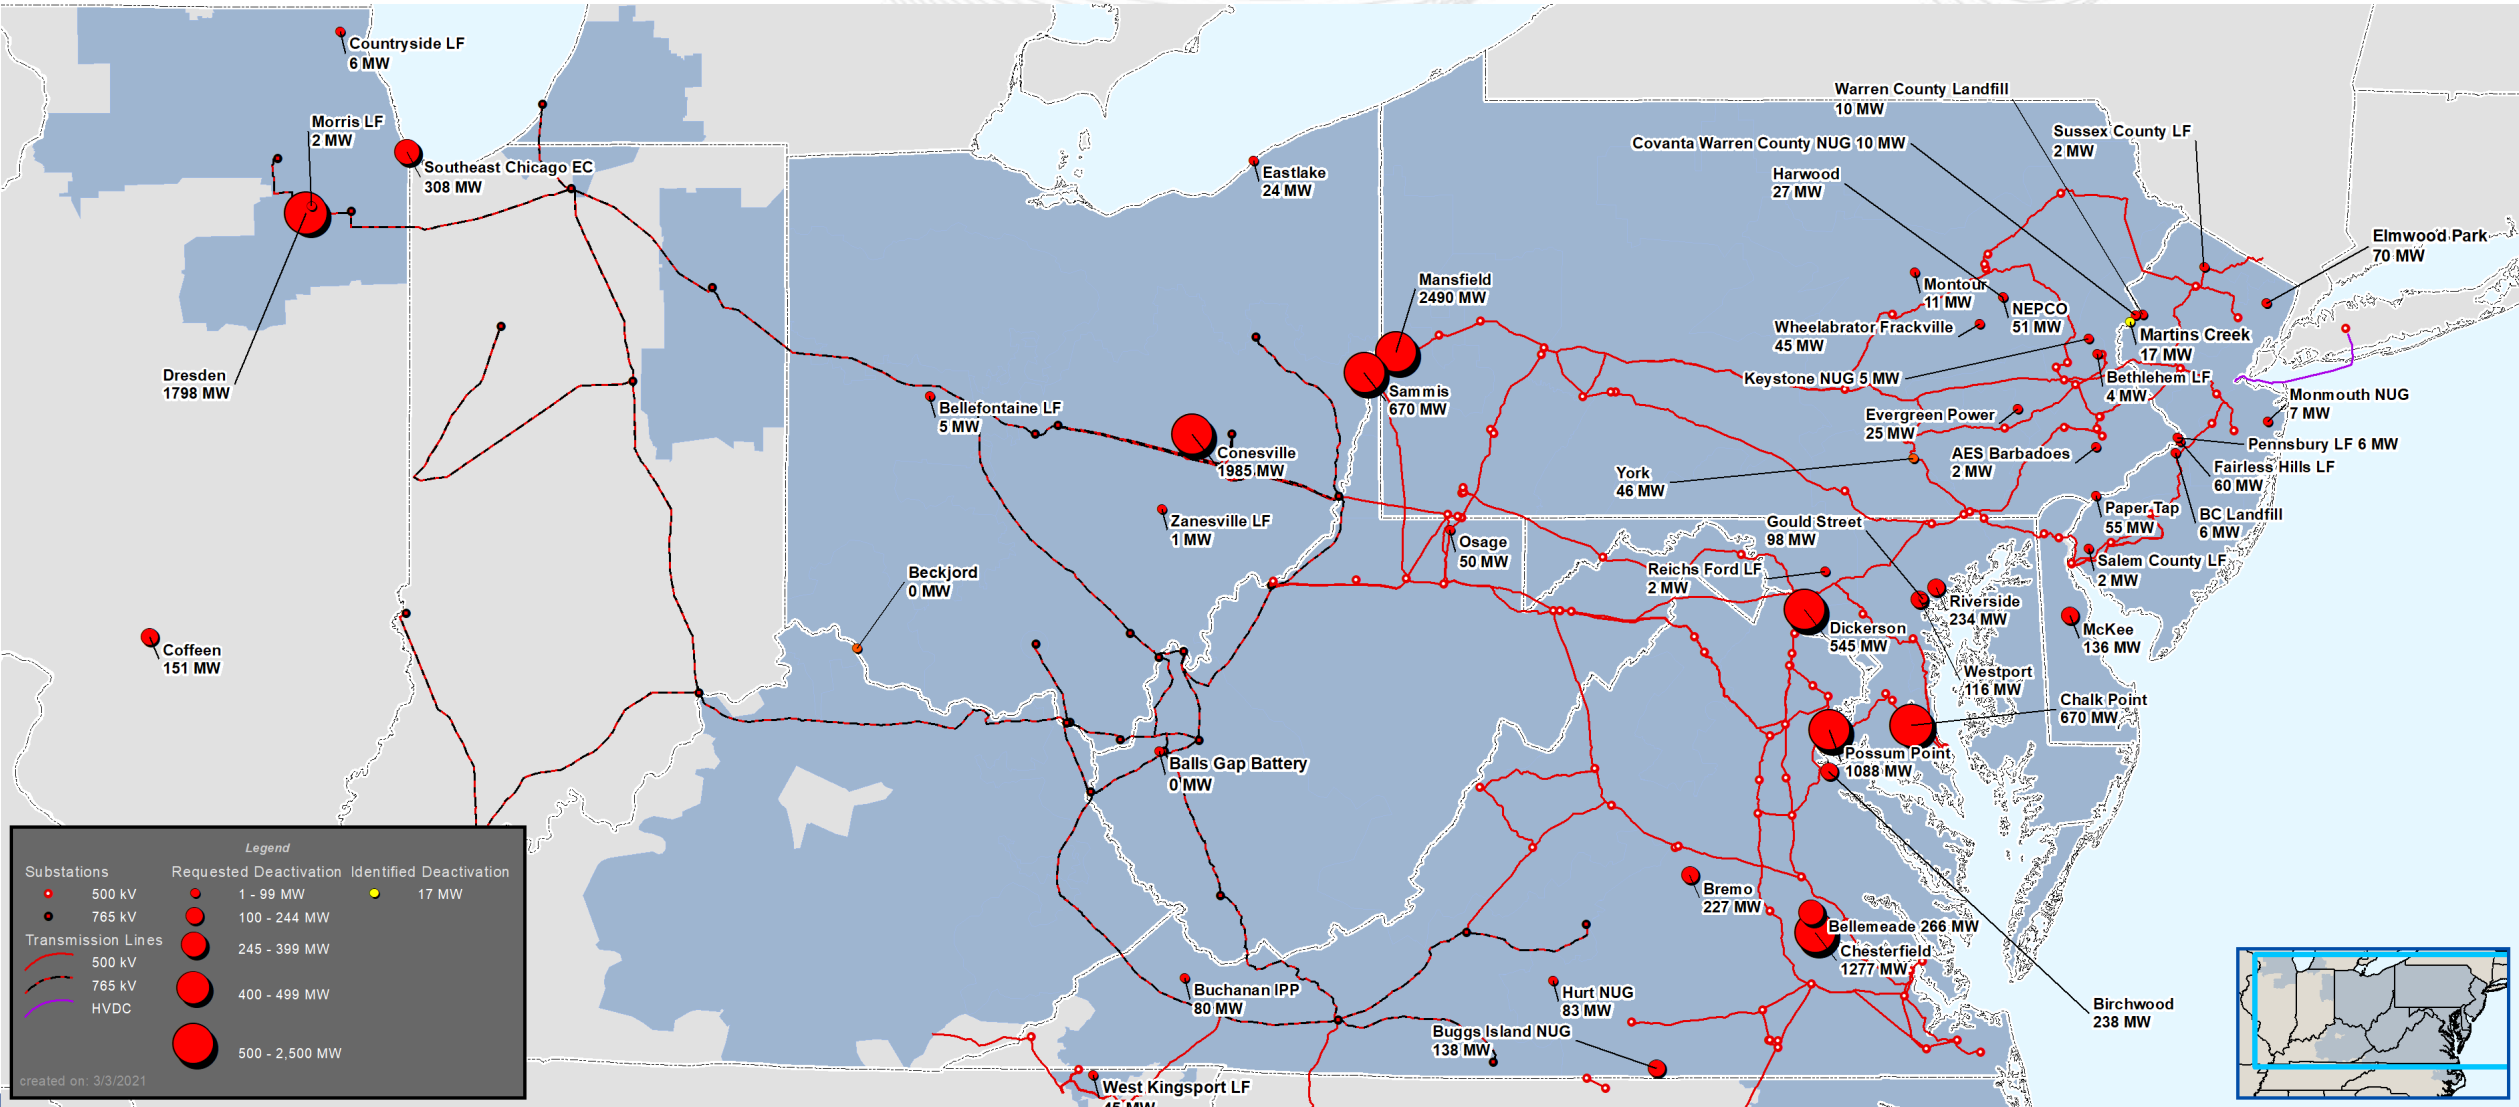

Unit(s)	Transmission Zone	Requested Deactivation Date	PJM Reliability Status
Martins Creek CT4 (17.3 MW)	PPL	05/31/2022	Reliability analysis complete. No violation identified.

Facilitator:
Sue Glatz,
Suzanne.Glatz@pjm.com

Secretary:
Michael Zhang,
Michael.Zhang@pjm.com

SME/Presenter:
Phil Yum,
Phil.Yum@pjm.com

Generation Deactivation Notification



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com

- V1 - 3/31/21 - Original slides posted.